


COUNTY OF HENRICO
DEPARTMENT OF PUBLIC UTILITIES

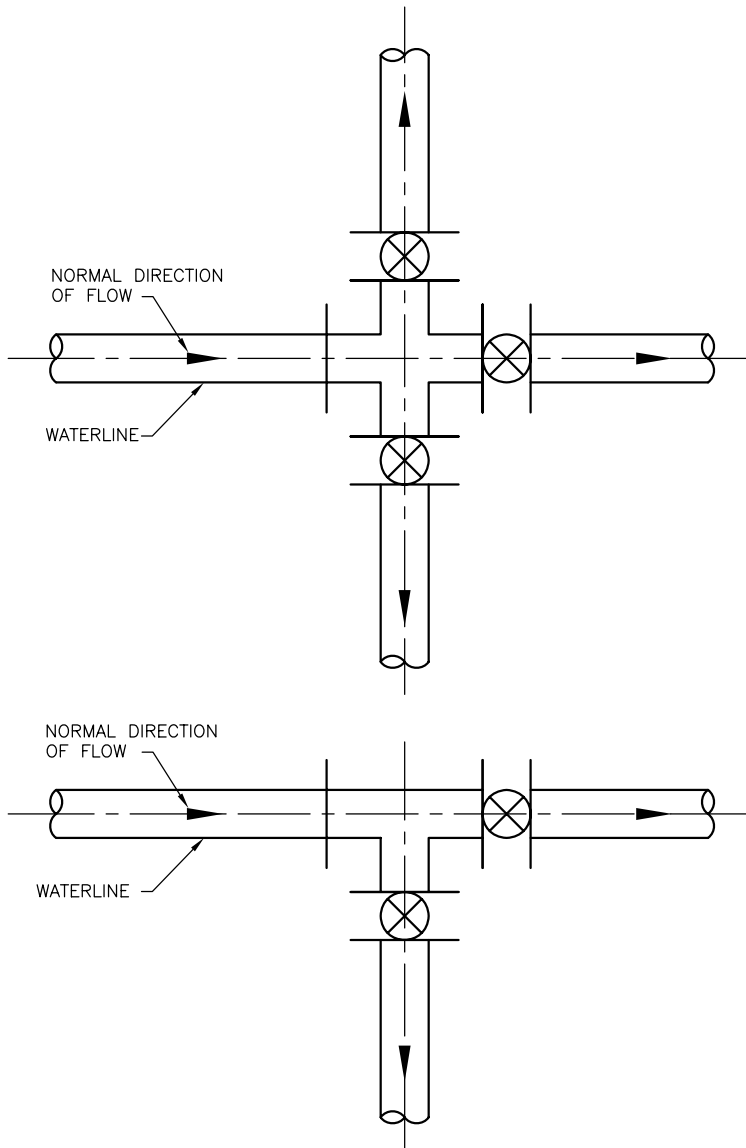

NOTES:

1. WHEN THERE IS A TEE BRANCH IN A WATERLINE THERE SHALL BE A VALVE ON EACH SIDE OF THE BRANCH (AS SHOWN).
2. WHEN THERE IS A CROSS BRANCH IN A WATERLINE THERE SHALL BE A VALVE ON EACH SIDE OF THE BRANCHES (AS SHOWN).

REVISIONS
06/20/2014

WATERLINE VALVES
AT TEE AND CROSS BRANCHES

DRWG. NO.
D-480