


COUNTY OF HENRICO DEPARTMENT OF PUBLIC UTILITIES

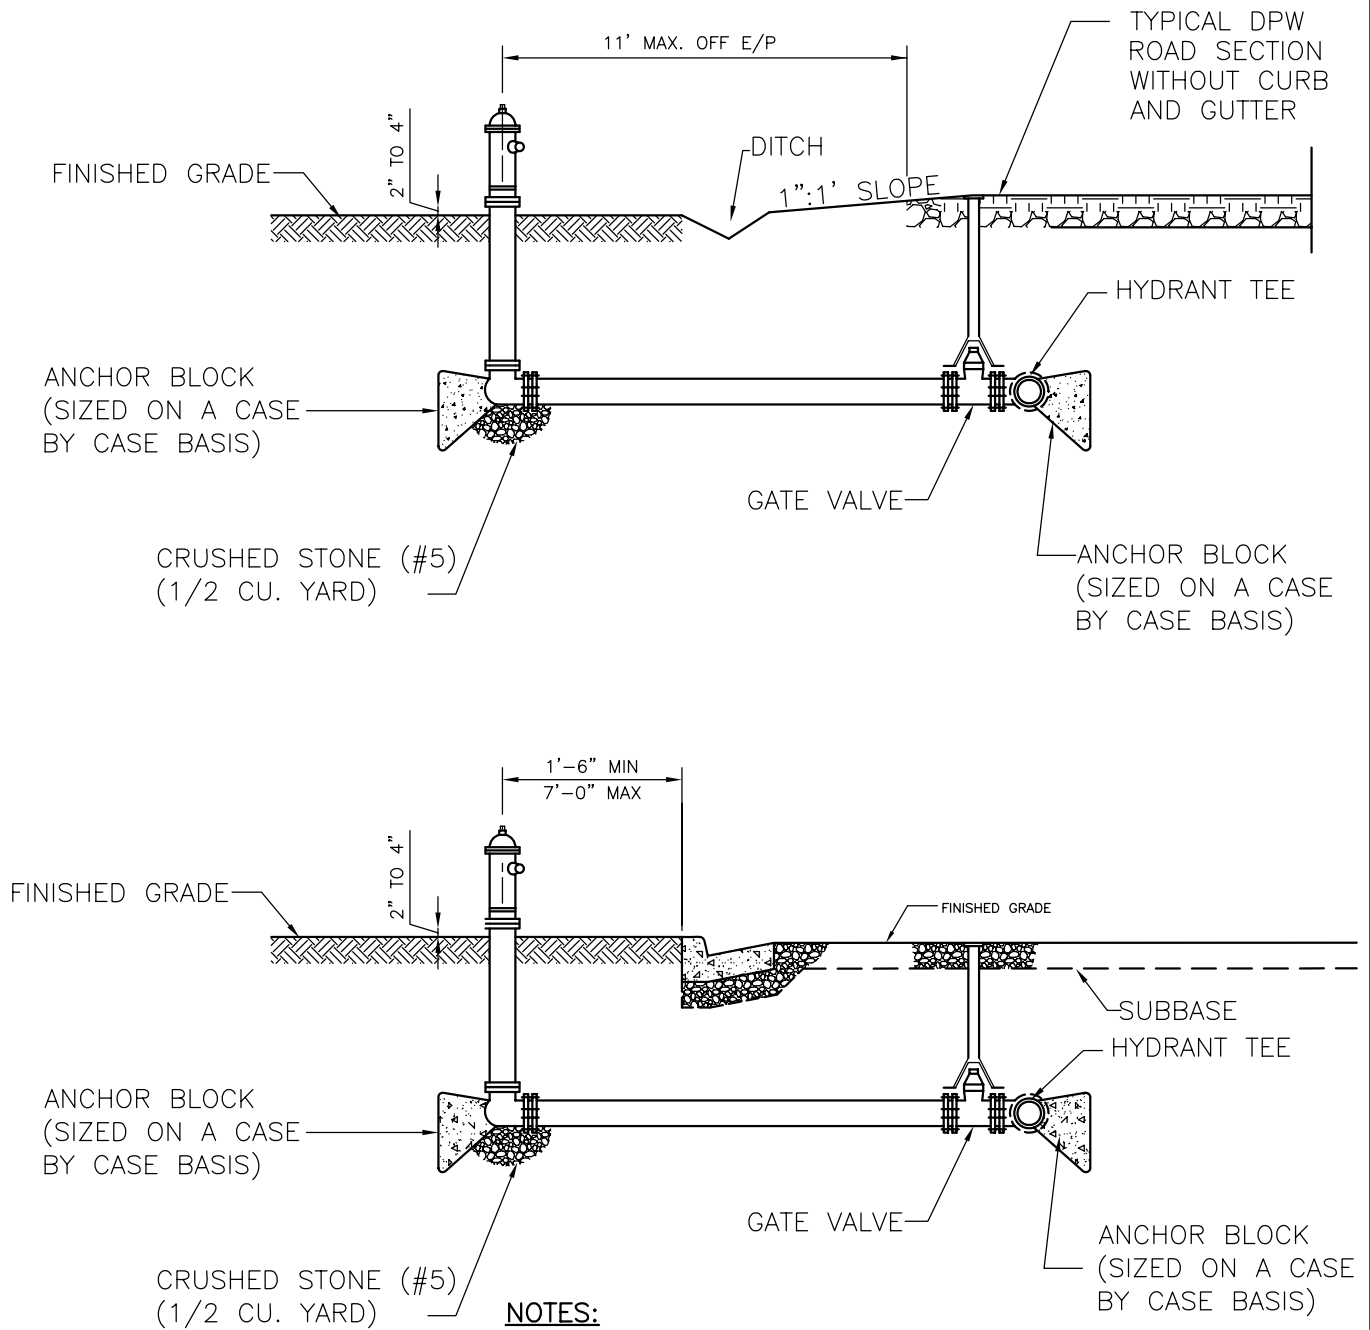

NOTES:

1. USE RESTRAINED JOINTS ON GATE VALVE, FIRE HYDRANT, AND PIPING.
2. DUCTILE IRON PIPE IS REQUIRED FOR ALL FIRE HYDRANT, AND PIPING.
3. HYDRANTS SHALL BE LOCATED A MINIMUM DISTANCE OF 50' FROM ALL STRUCTURES.
4. KEEP WEEP HOLE CLEAR TO ALLOW PROPER DRAINAGE.

REVISIONS
06/20/2014

TYPICAL FIRE HYDRANT DETAIL

DRWG. NO.
D-495-1