
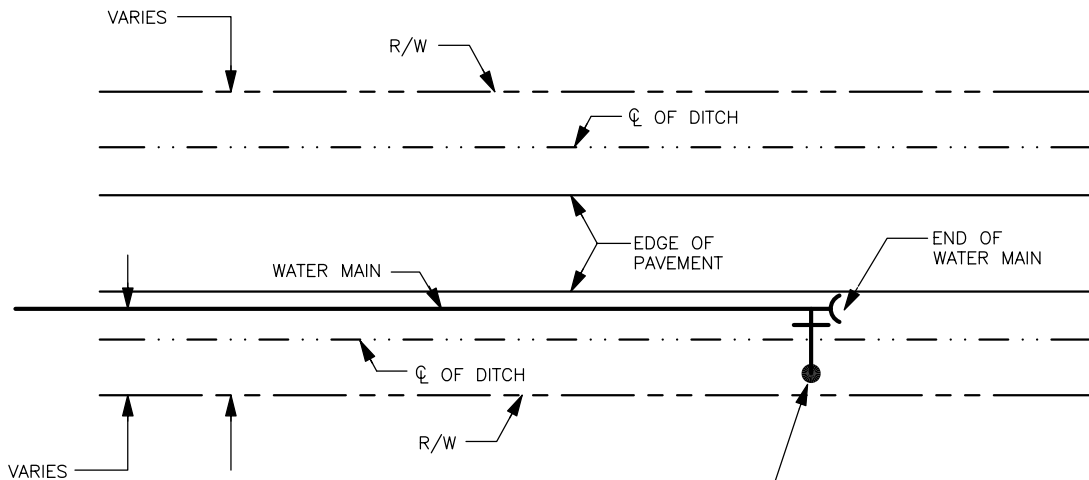


COUNTY OF HENRICO DEPARTMENT OF PUBLIC UTILITIES

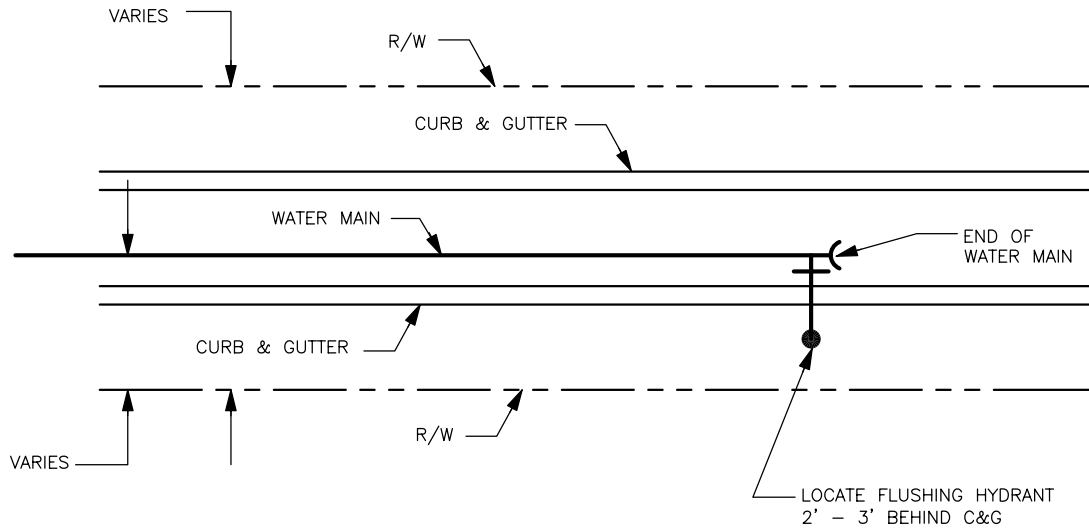

NOTE:

1. SEE STANDARD DRAWING D-500 FOR INSTALLATION OF FLUSHING HYDRANTS.

LOCATE FLUSHING HYDRANT 2'± INSIDE R/W LINE ON LEVEL GROUND. IF THIS IS NOT POSSIBLE, CONSULT THE UTILITY CONSTRUCTION INSPECTOR.

REVISIONS 06/20/2014	TYPICAL FLUSHING HYDRANT LOCATION ON THROUGH STREET	DRWG. NO. D-505-2
-------------------------	--	----------------------