
COUNTY OF HENRICO DEPARTMENT OF PUBLIC UTILITIES

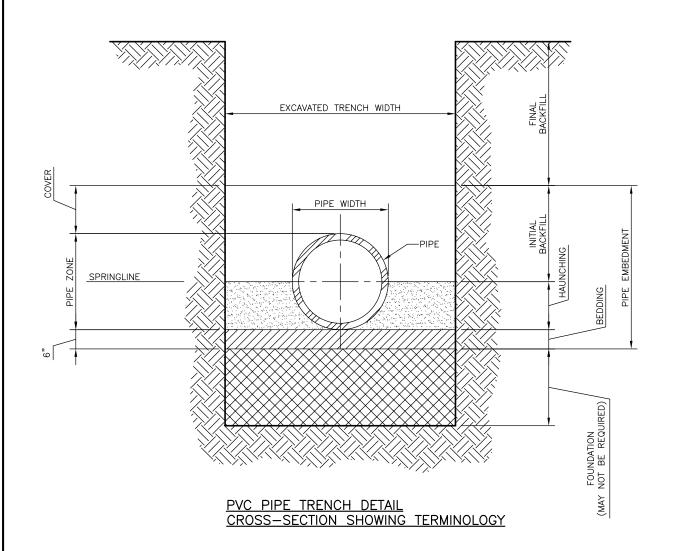

NOTE:

1. IN GENERAL BEDDING AND HAUNCHING SHALL BE FREE FLOWING GRANULAR MATERIALS ADEQUATELY COMPACTED. IN THE EVENT THAT SUBSOILS ARE DEEMED INADEQUATE THE DESIGN ENGINEER MAY REQUIRE IMPORTED FOUNDATION MATERIAL SUCH AS #57 STONE. THE MINIMUM TRENCH WIDTH SHALL CONFORM TO TABLE 710.1 LOCATED ON DRAWING D-710-2.

REVISIONS 06/20/2014 DRWG. NO.